


NOTES:
ALL WORK AND MATERIAL TO BE IN ACCORDANCE WITH
NJDOT SPECIFICATIONS

CURB/ROADWAY RESTORATION DETAIL NTS

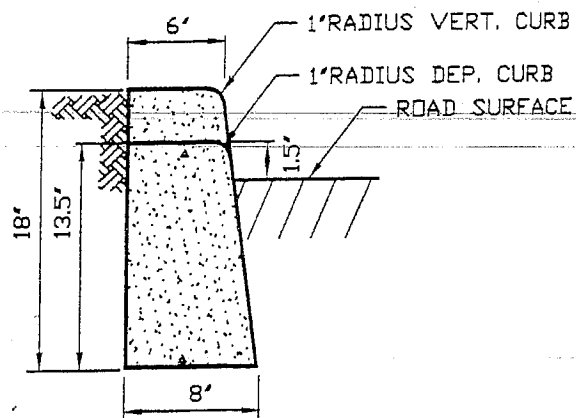


NOTES:

1. CONCRETE TO BE 4,000 psi MINIMUM
2. SIX (6") INCH FACE TO BE PROVIDED ON CURB, 1-1/2" ON DEPRESSED CURB.
3. PROVIDE PREFORMED BITUMINOUS FIBER EXPANSION JOINTS, 1/2" THICK AT 20'.0" (MAX.) INTERVALS. PROVIDE DUMMY JOINTS (FORMED) MIDWAY BETWEEN EXPANSION JOINTS.
4. DEPTH TO BE FULL 18' INCLUDING DEP. CURB.

DEP. CONC. CURB DETAIL

NOT TO SCALE

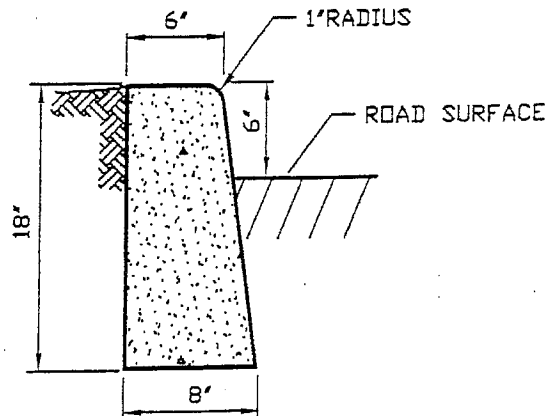

NOTES:

1. CONCRETE TO BE 4,000 psi MINIMUM
2. SIX (6") INCH FACE TO BE PROVIDED ON CURB, 1-1/2" ON DEPRESSED CURB.
3. PROVIDE PREFORMED BITUMINOUS FIBER EXPANSION JOINTS, 1/2" THICK AT 20'.0" (MAX.) INTERVALS. PROVIDE DUMMY JOINTS (FORMED) MIDWAY BETWEEN EXPANSION JOINTS.
4. DEPTH TO BE FULL 18' INCLUDING DEP. CURB.

VERT. CONC. CURB DETAIL

NOT TO SCALE